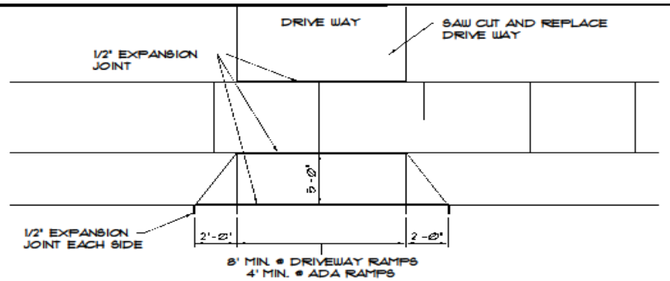

PLAN

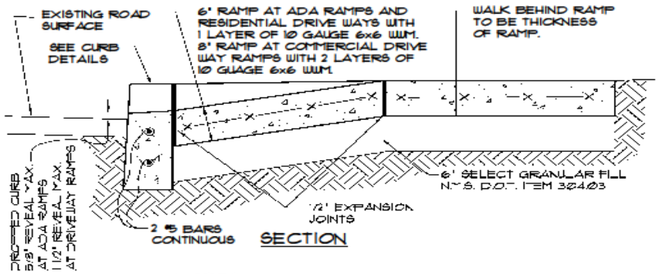

SECTION

NOTES:

1. ALL CONCRETE SHALL BE MINIMUM 4,000 PSI.

DRIVEWAY RAMPS & ADA RAMP

SCALE: 1"-1'-0"

CITY OF KINGSTON PUBLIC WORKS DEPT 25 East O'Reilly St KINGSTON, NY 12401	FILE NO.: 001-DET DATE: 3-6-00 SCALE: AS NOTED DRAWN BY: JP	DRIVEWAY & ADA RAMP DETAIL	1 PAGE NO.

RESTORATION CUT AWAY EXAMPLE

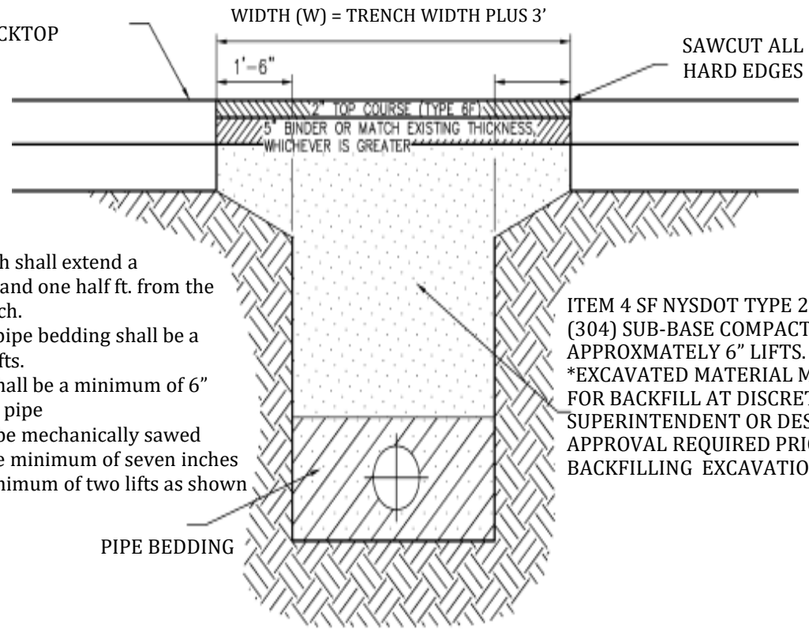

NOTES:

1.Pavement width shall extend a minimum of one and one half ft. from the edges of the trench.
2.Backfill above pipe bedding shall be a minimum of 6" lifts.
3.Pipe bedding shall be a minimum of 6" above and below pipe
4.All joints shall be mechanically sawed
5.Asphalt shall be minimum of seven inches and placed in minimum of two lifts as shown

UTILITY TRENCH DETAIL IN PUBLIC R.O.W.